



DWG: \\mna-dp\Projects\Cambria\CSD\Cambria2024-001\Stuart\Sheet Tanks Replacement\00 Engineering\01 CAD\Planes\C-103.dwg - Plotted by: Jim Froelicher Date: 6/25/2024 - 2:15 PM
 XREFS: C:\BDD\Images\CSD_Logo.PNG - CallMKN.org

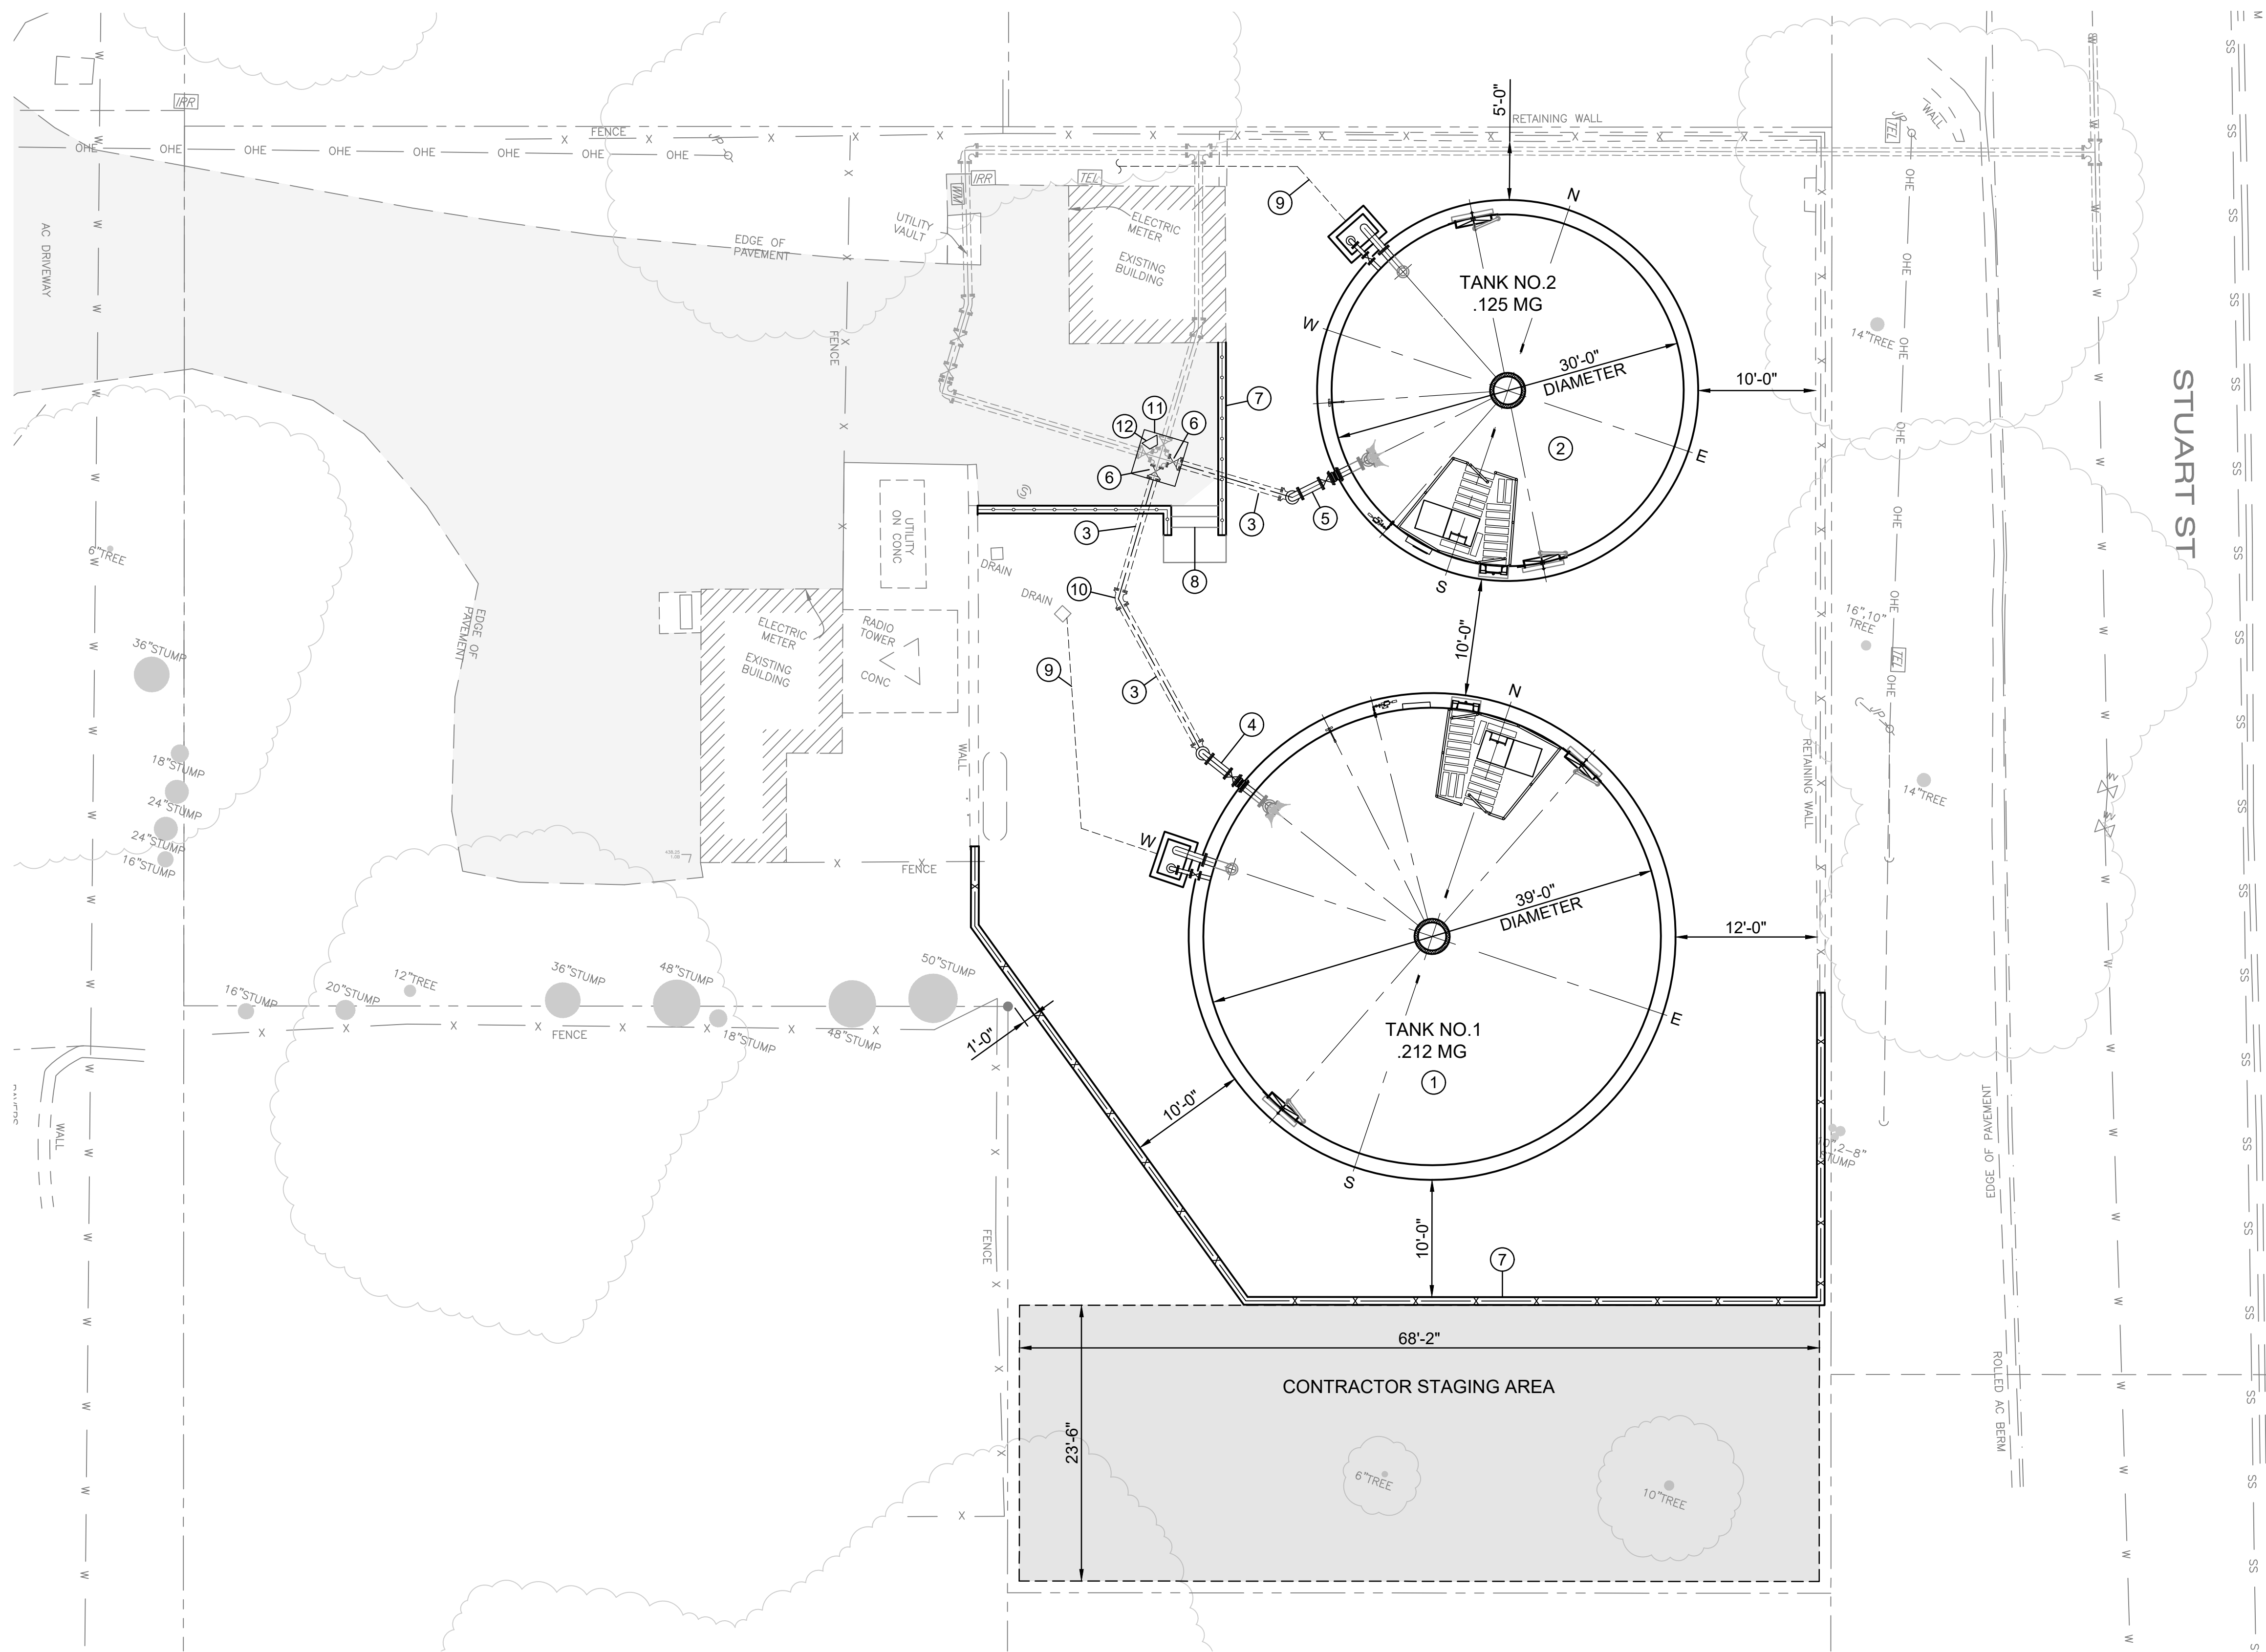

SITE PLAN
SCALE: 1" = 8'

TANK	DIAMETER	MAXIMUM OPERATING LEVEL	FREEBOARD	TANK HEIGHT	RINGWALL FOOTING	
					DEPTH	WIDTH
1	39.0 ft	23.0 ft	3.0 ft	26.0 ft	30 in	30 in
2	30.0 ft	23.0 ft	3.0 ft	26.0 ft	30 in	30 in

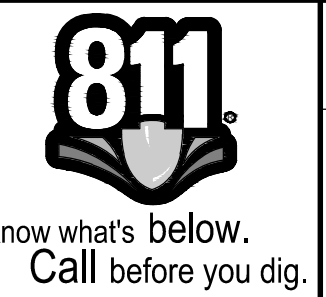

CONSTRUCTION NOTES:

- ① 0.212 MG AWWA D100 WELDED STEEL WATER STORAGE TANK, SEE SHEET C-104
- ② 0.125 MG AWWA D100 WELDED STEEL WATER STORAGE TANK. SEE SHEET C-105
- ③ INSTALL 8-INCH DIP PER SPECIFICATION SECTION 402040
- ④ TANK NO.1 CONNECTION PER DETAIL 1 C-501
- ⑤ TANK NO. 2 CONNECTION PER DETAIL 1 C-501
- ⑥ 8-INCH GATE VALVES, FLGxMJ
- ⑦ RETAINING WALL PER DETAIL 22 S-202
- ⑧ CONCRETE STAIRS PER DETAIL X C-50X
- ⑨ 6-INCH PVC STORM DRAIN. CONNECT TO (E) DRAIN SYSTEM
- ⑩ 8-INCH 45° D.I. ELBOW, MJxMJ
- ⑪ PROTECT IN PLACE (E) 4'x4'x18" CONCRETE PAD BELOW CROSS
- ⑫ THRUST BLOCK

GENERAL NOTES:

1. SUBMIT CONSTRUCTION PHASING PLAN PER SPECIFICATION SECTION 011100.
2. ALL BURIED DUCTILE IRON PIPE AND FITTINGS SHALL BE MECHANICALLY RESTRAINED PER SPECIFICATION SECTION 402040.
3. ONLY DISTRICT PERSONNEL WILL OPERATE EXISTING VALVES AND EQUIPMENT. COORDINATE WITH DISTRICT AND PROVIDE 72-HOUR NOTICE PER SPECIFICATION SECTION 011000.
4. INSTALL BURIED PIPING PER SPECIFICATION SECTION 312316.

<p style="font-size: 8px; margin: 0;"> 354 PACIFIC STREET SAN LUIS OBISPO, CA 93401 (805) 329-4773 </p>	<p style="font-size: 8px; margin: 0;"> SITE PLAN CAMBRIA COMMUNITY SERVICES DISTRICT STUART STREET TANKS REPLACEMENT PROJECT </p>
<p>DESIGNED: JEH DETAILED: JPF CHECKED: --- APPROVED: --- DATE: JUNE 2024</p>	<p>PROJECT NO. C-103 SHEET 6 OF 18</p>

FOR PRELIMINARY USE ONLY
 NOT TO BE USED FOR CONSTRUCTION

DATE: JUNE 2024
****30% DRAFT PLANSET - NOT FOR CONSTRUCTION**